

Minimum Distances:

STEEL TO SUBSTRATE 30MM

STEEL TO COMBUSTIBLE 50MM

STEEL TO STEEL 30MM

STEEL TO CABLES 0MM

CABLE TO SUBSTRATE 0MM

TRUNKING TO SUBSTRATE 0MM

COPPER TO SUBSTRATE 30MM

INSULATED TO SUBSTRATE 30MM

CABLE TRAY TO SUBSTRATE 0MM

For use within:

FB750 Intubatt



FR230 Intucompound

FS702 Intumastic Soft Joint

Fire Dampers should be maintained within a separate seal. If including every effort should be made to keep a minimum 200mm separation to other Fire Dampers, Ducts or typical penetrating services.


Distances Shown are applicable to Vertical & Horizontal Applications within a Flexible Wall, AAC slab- Wall, Concrete Floors & Concrete Walls.

Guidance should be sought for timber or isowall substrates.

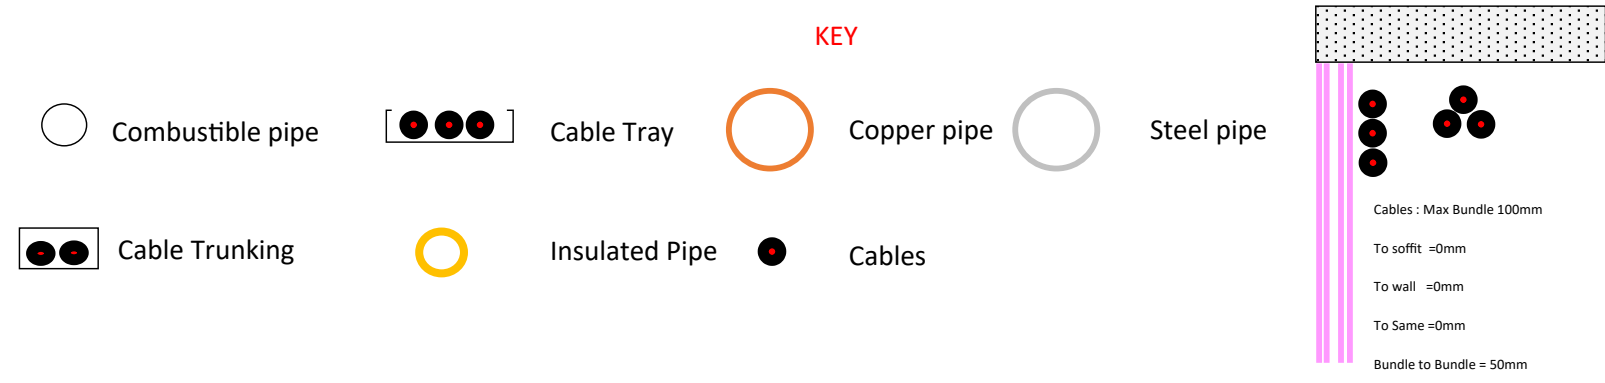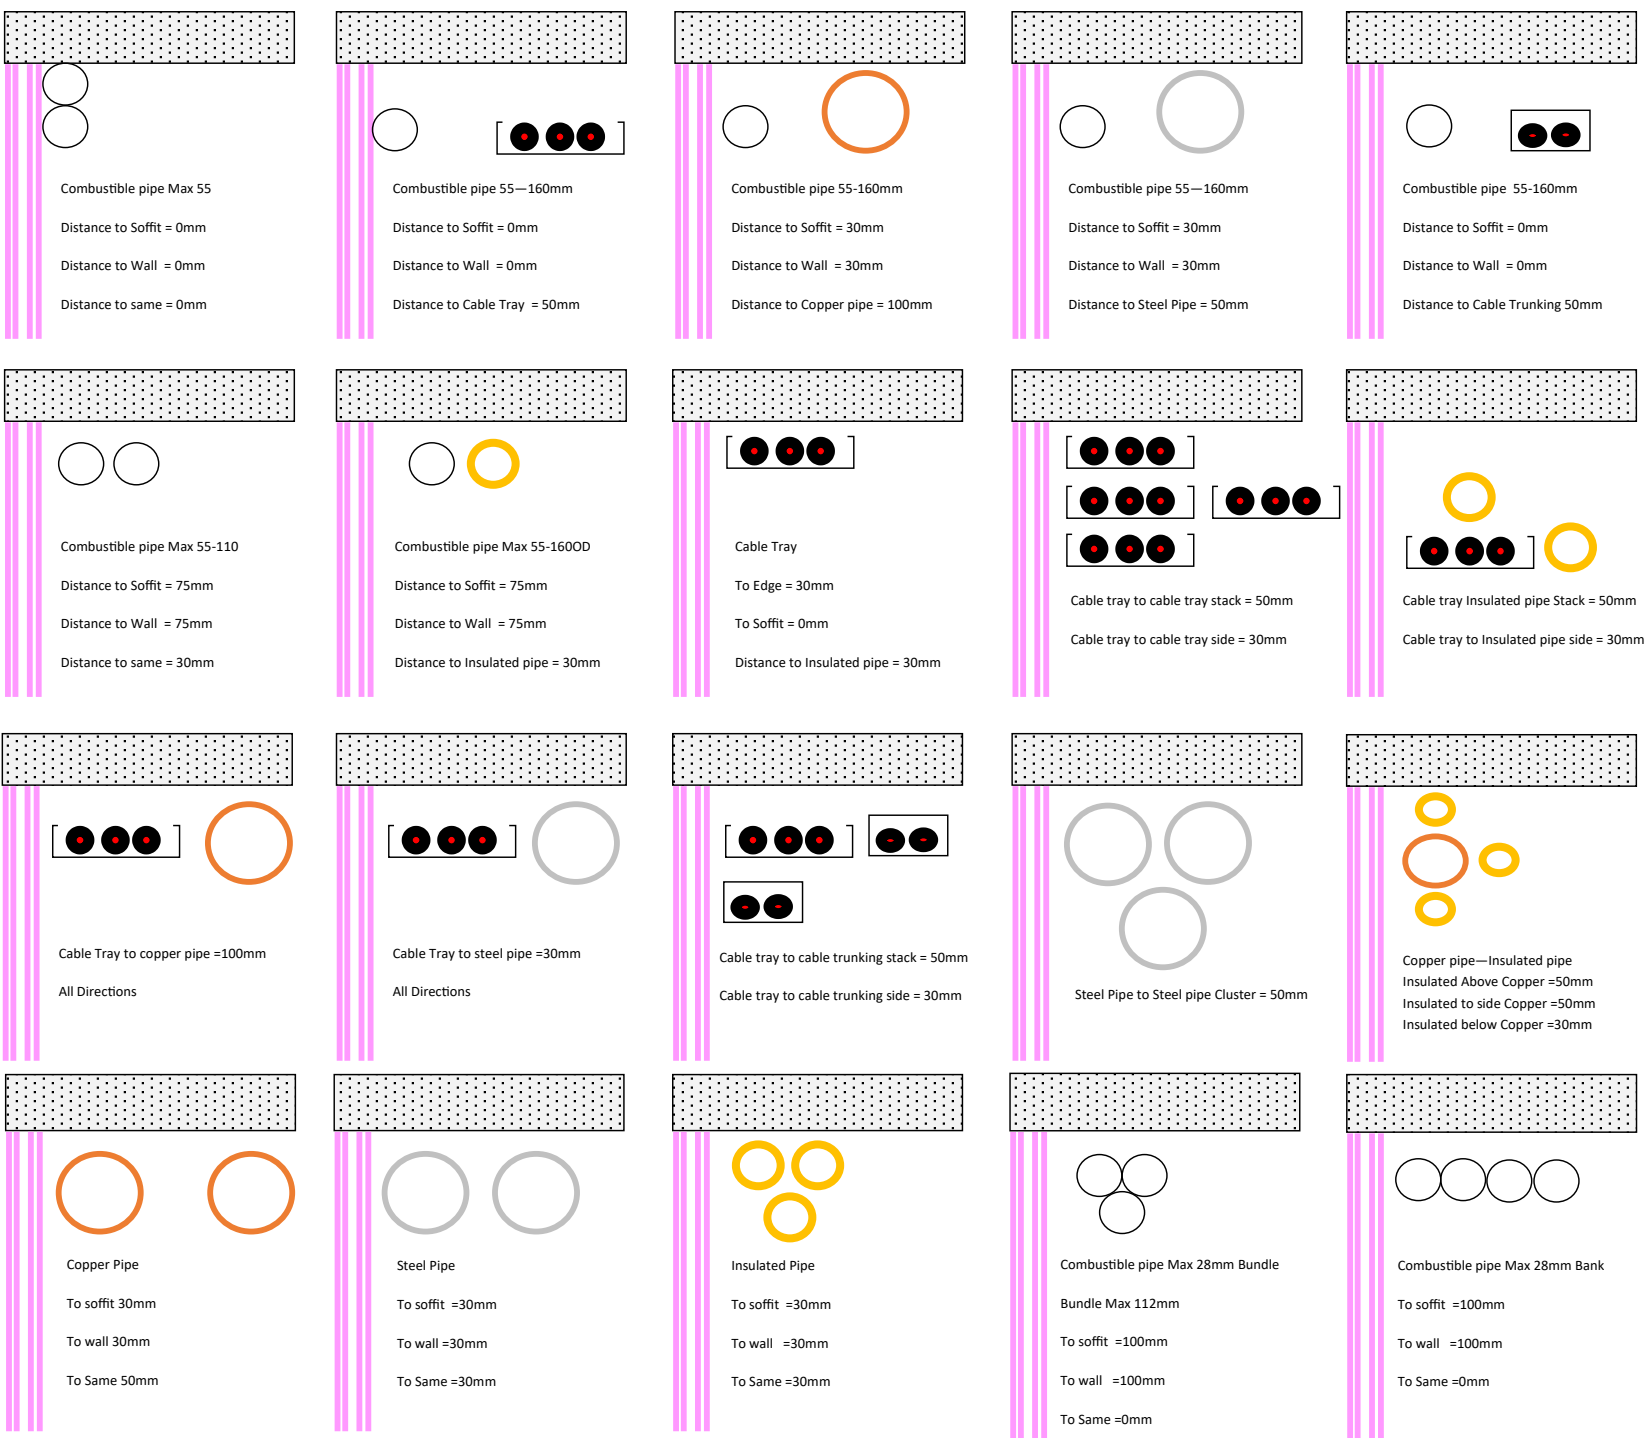

The published fire ratings have been achieved by following the instructions set out above. Use of alternative components or deviations from the instructions in anyway will remove Nullifire from any design liability. Nullifire will not accept responsibility for the consequences of the using our products in applications or purposes not authorised by Nullifire. Expert advise should be sought where such applications are contemplated. The information contained within this drawing is believed to be correct on the date of publication, and is based upon tested and certified solutions. The policy of Nullifire is one of constant improvement. Installers must therefore ensure that they are following the latest published drawings and instructions. Whilst we will endeavour to keep our publications up to date, the accuracy of the information contained within this drawing may be affected by pertinent changes in the law or regulatory requirements and alternations/amendments to the specification of Nullifire products. For more information, please contact a member of our technical team on: firestoppinghelp@cpgeurope.com

Test derivation example:

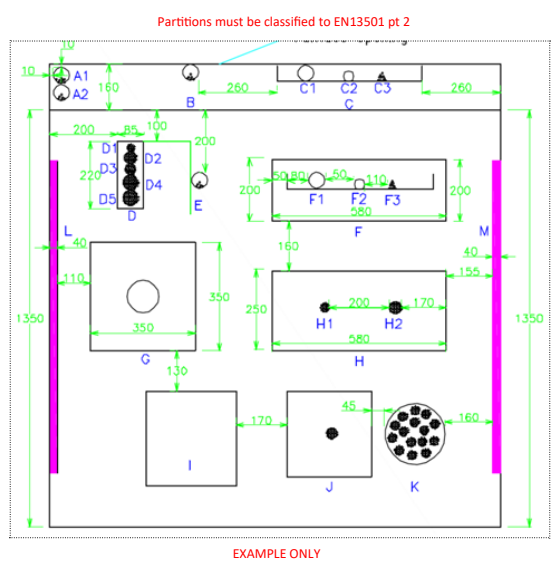

Note:
Practical application distance may be greater than tested minimum distances. The requirement for correct applica on must be considered at all times.

Tested to:

Services BS EN 1366-3

Drawing Title:

Distances

Drawing Reference No:

711a

Additional Information:

Scale: NTS
Date: January 2021
Sheet Size: A3
Drawn By:
Drawing No: 1058181220
Rev: 1.0